


THE INFORMATION CONTAINED HEREON IS PROPRIETARY AND CONFIDENTIAL TO AQUATEC WATER SYSTEMS, INC. AND SHALL NOT BE USED OR DISCLOSED IN WHOLE OR IN PART WITHOUT FIRST OBTAINING THE WRITTEN PERMISSION OF AQUATEC WATER SYSTEMS, INC.

**AQUATEC WATER SYSTEMS
BOOSTER PUMP SYSTEM
TYPICAL UNDERCOUNTER INSTALLATION
PSW, ESO AND LPS SHOWN**

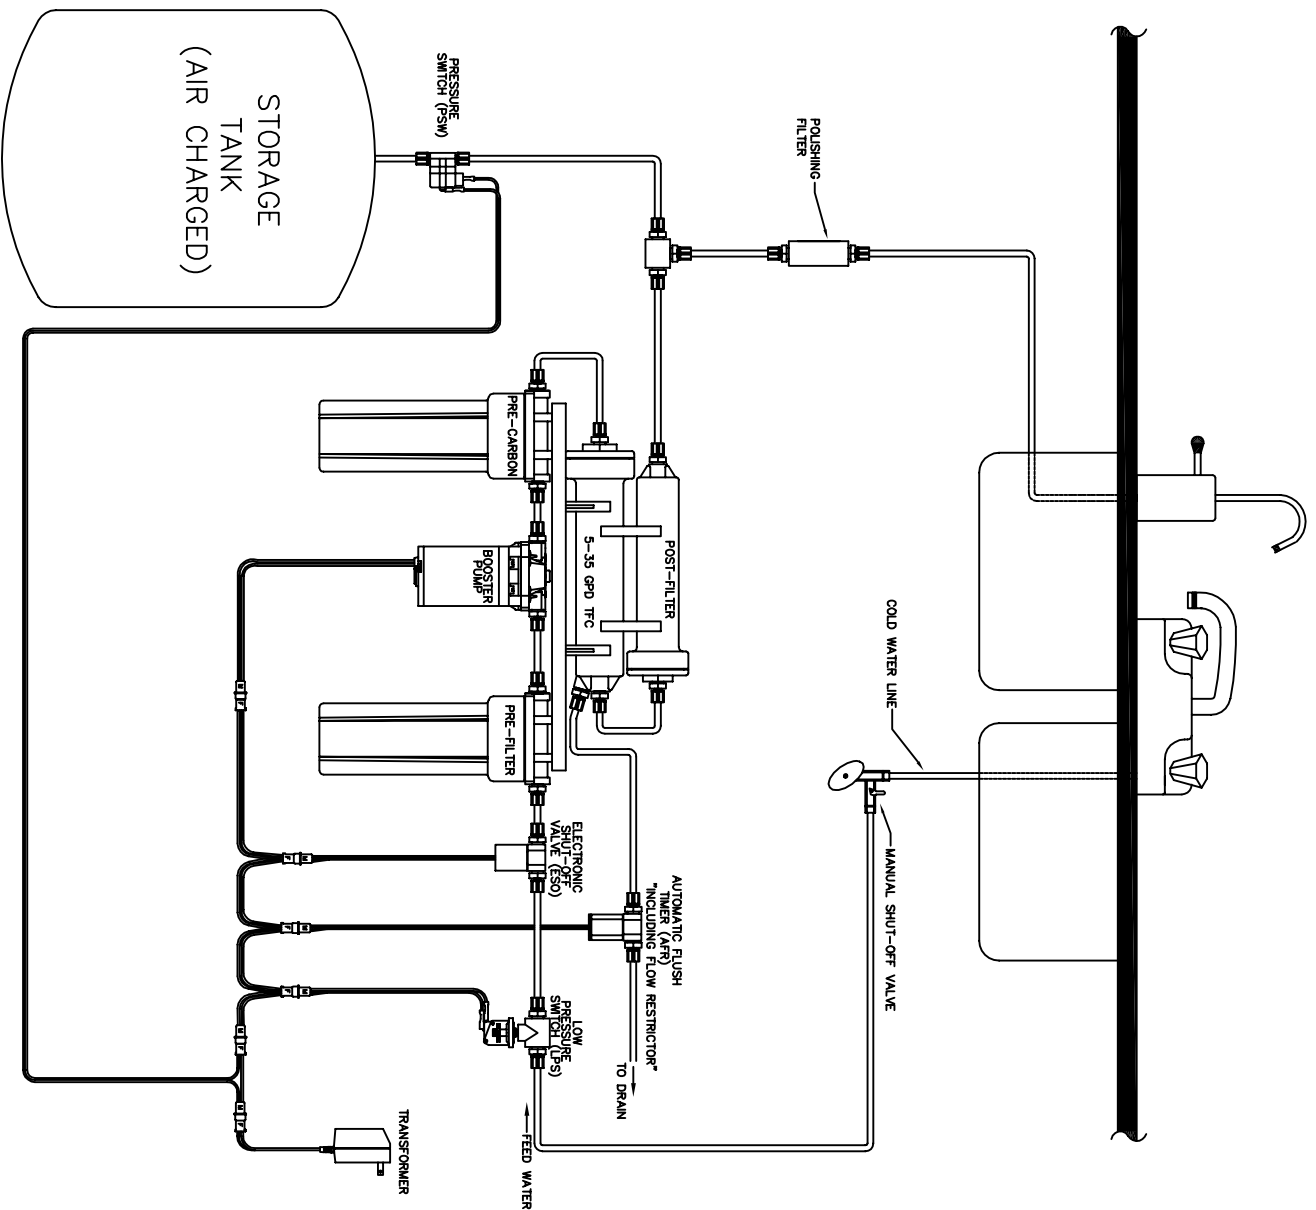

REVISIONS				
REV	DESCRIPTION	DATE	DRAWN	APPROVED
A	ECO #2535, RELEASE FOR PRODUCTION	7/17/02	E.G.	

CAD# IMI-134	
PRODUCT CODE	
NEXT ASSY	USED ON
APPLICATION	

UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES AT 65°F TOLERANCES ARE:
 FRACTIONS: DECIMALS: ANGLES:
 ±1/64 .X = .030 ±1/2°
 .XX = .010
 .XXX = .005

Ø CONCENTRICITY .005 T.I.R.
 1. PERPENDICULARITY .0005/IN.
 ANGULAR DIMS FOR CHAMFS & CSINKS ±2°
 FILET RADII .010 TO .030
 BREAK CORNERS .005 TO .015 R. OR CHAMF
 FINISH AA 125 MICRO IN. PER ANSI B46.1

GEOMETRIC SYMBOLS PER ANSI-Y14.5

DO NOT SCALE DRAWING

MATERIAL	N/A		AQUATEC WATER SYSTEMS INC. 17422 Pullman St., Irvine, Ca. 92614	
FINISH			SYSTEM/INSTALLATION DRAWING	
APPROVALS	DATE	DESIGNED	SIZE	SCALE
DRAWN E.G.	7/17/02		B	NONE
CHECKED			PART/DWG NO.	REV
SHEET 1 OF 1			IMI-134	A